


CEILING HEIGHT 9'0"

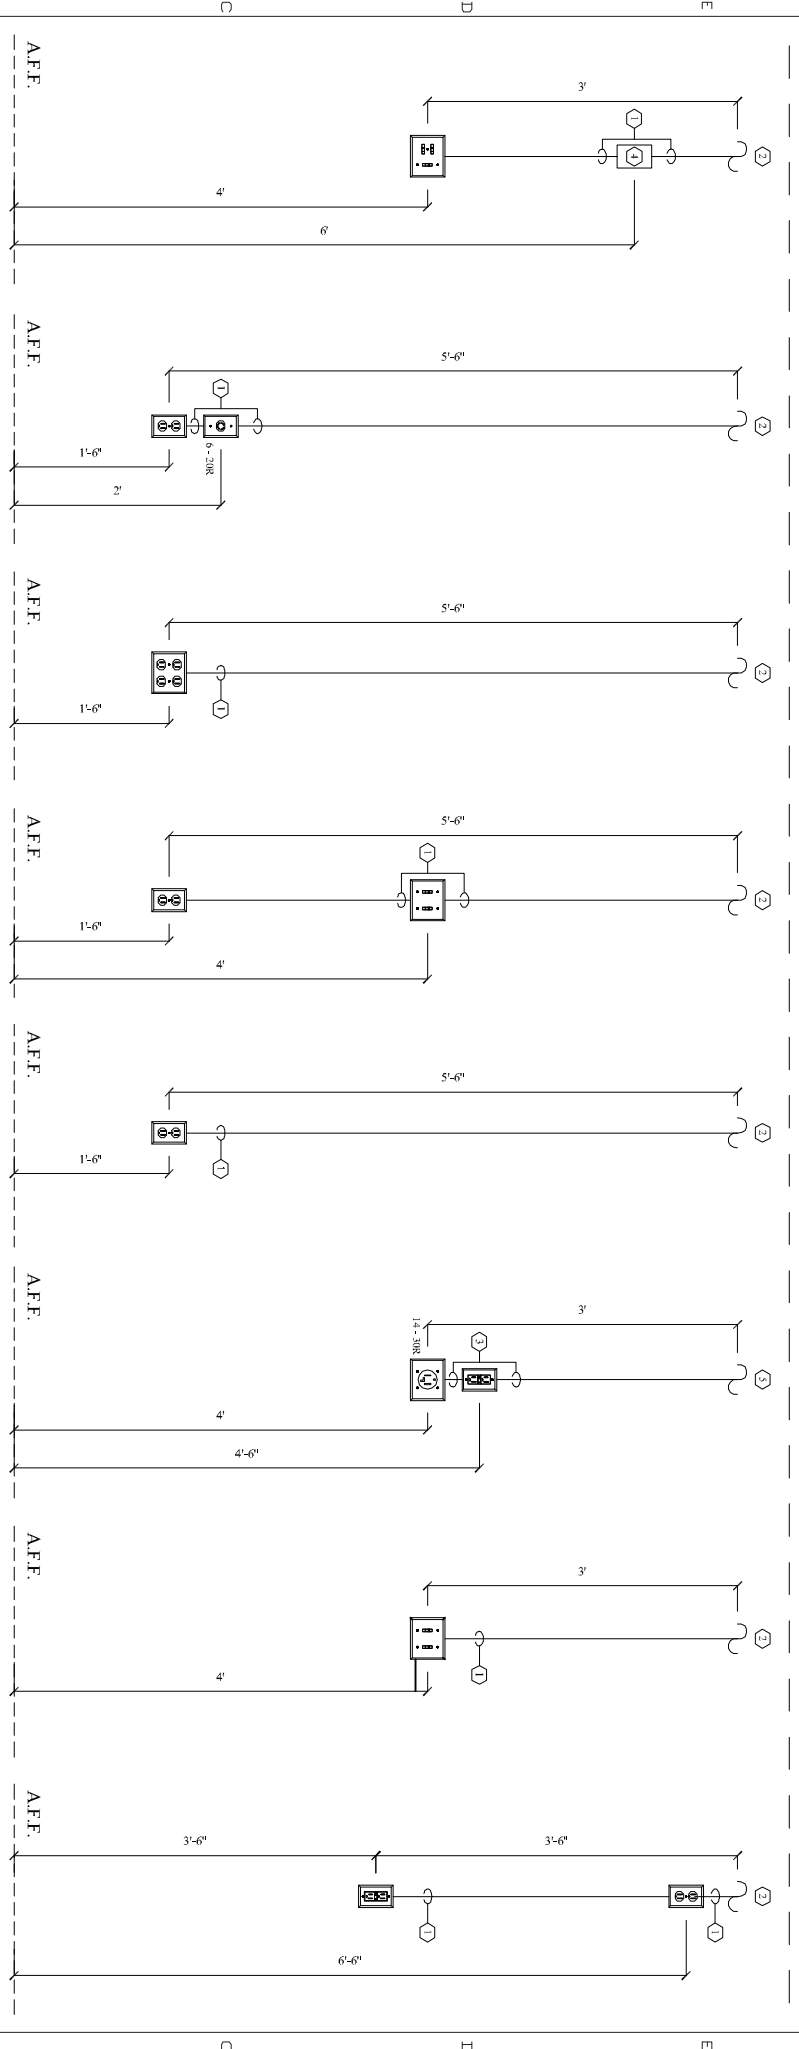

ELECTRICAL NOTES:

- ① 1/2" SCHEDULE 80 PVC
- ② CONNECT TO JUNCTION BOX ABOVE WITH 1/2" FLEXIBLE CONDUIT.
- ③ 3/4" SCHEDULE 80 PVC
- ④ TERMINATE CIRCUIT #10 IN 2 GANG SWITCH BOX FOR FUTURE BASE BOARD HEATER.
- ⑤ CONNECT TO JUNCTION BOX ABOVE WITH 3/4" FLEXIBLE CONDUIT.

5	BEDROOM #1 (QTY 2)
5	BEDROOM #2 (QTY 1)
5	LIVING ROOM (QTY 1)

6	LAUNDRY RM. (QTY 1)
---	---------------------

7	BEDROOM #1 (QTY 1)
---	--------------------

8	BATHROOM VANITY (QTY 1)
---	-------------------------

REV	DESCRIPTION	DRAWN	VERIFIED	DATE
<p>Silver Coastal Developers Ph. 713.748.0463 Fax. 713.748.0472 8925 Burdell Houston, Texas 77021 www.silvercoastal.com</p>		<p>Client: FEMA / TDHCA</p>		
<p>Title: 2 BEDROOM</p>		<p>DWG. N°: AHPP 2BR 1BA</p>		
<p>Subject: SWITCH AND RECEPTACLE ELEVATION DETAILS</p>		<p>SCALE: NTS</p>		
<p>For more information contact Mike Adams, c. 713.565.129</p>		<p>REF FILE: 1/2</p>		
<p>DATE: 07-20-08</p>		<p>DATE: 07-20-08</p>		
<p>DATE: 07-20-08</p>		<p>DATE: 07-20-08</p>		
<p>DATE: 07-20-08</p>		<p>DATE: 07-20-08</p>		